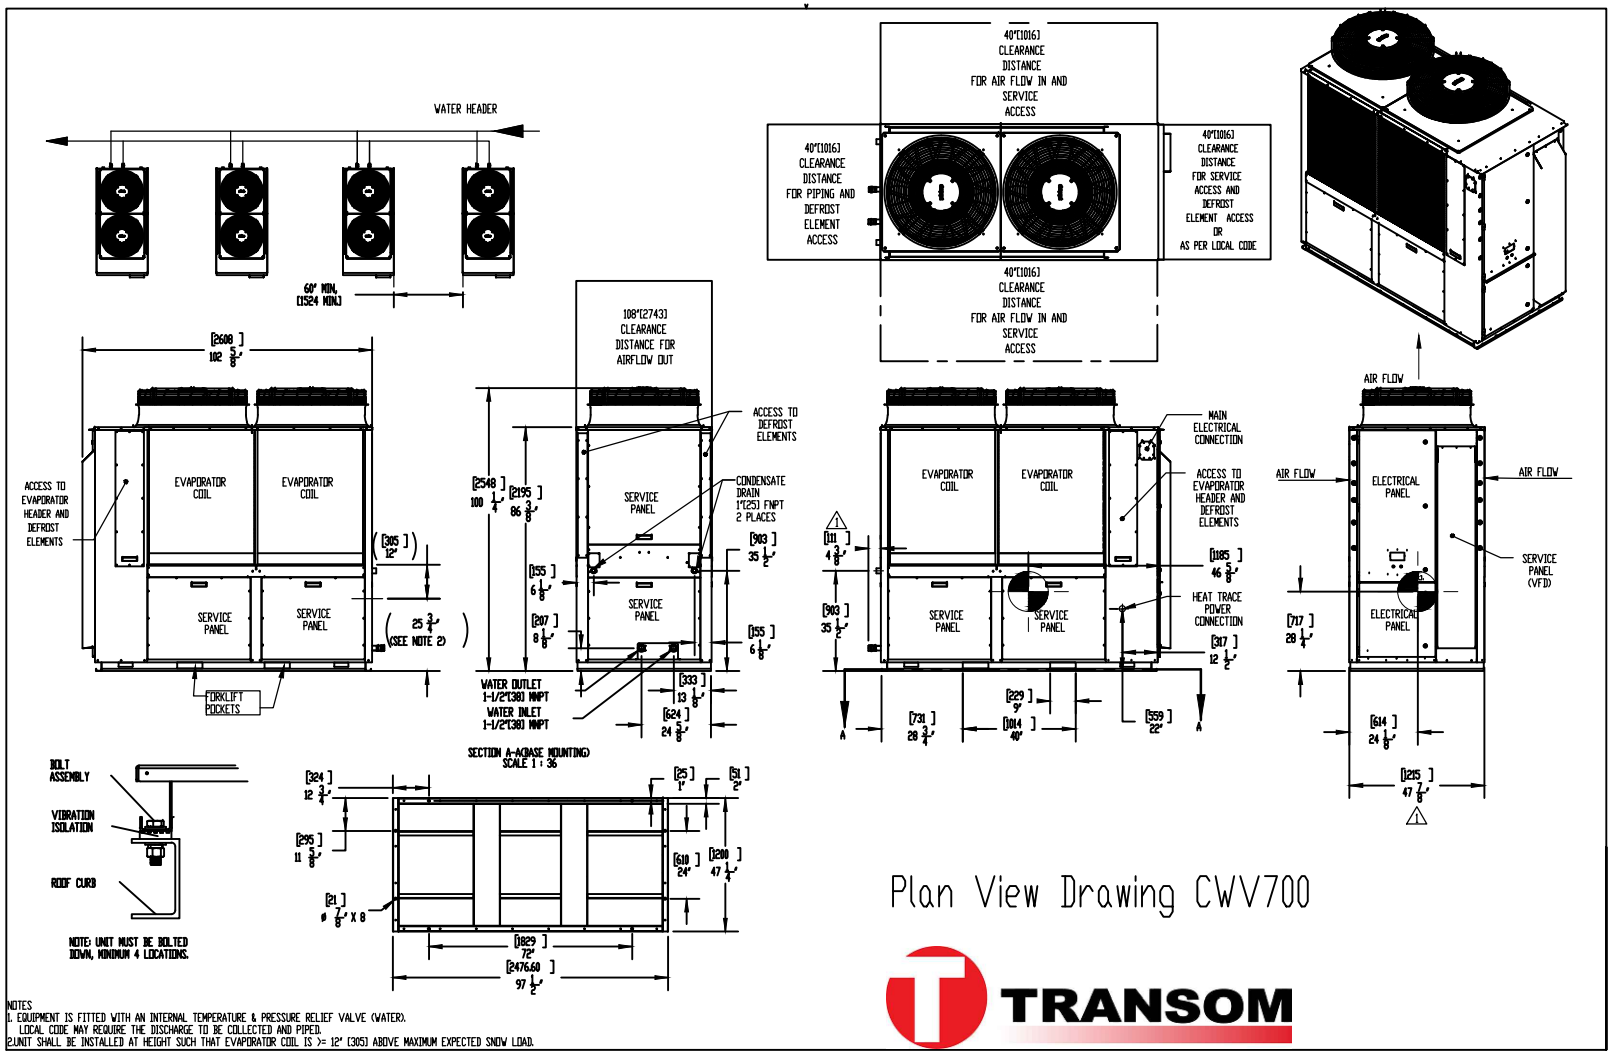

Plan View Drawing CWV700

TRANSOM

NOTES
1. EQUIPMENT IS FITTED WITH AN INTERNAL TEMPERATURE & PRESSURE RELIEF VALVE (WATER).
   LOCAL CODE MAY REQUIRE THE DISCHARGE TO BE COLLECTED AND PIPED.
2.UNIT SHALL BE INSTALLED AT HEIGHT SUCH THAT EVAPORATOR COIL IS >= 12" [305] ABOVE MAXIMUM EXPECTED SNOW LOAD.